Annual Environmental Report 2021



Milford

D0342-01

CONTENTS

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2021 AER

- 1.1 Annual Statement of Measures
- 1.2 Treatment Summary
- 1.3 ELV OVERVIEW
- 1.4 LICENSE SPECIFIC REPORT INCLUDED IN AER

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

- 2.1 MILFORD (DONEGAL) WWTP TREATED DISCHARGE
 - 2.1.1 INFLUENT SUMMARY MILFORD (DONEGAL) WWTP
 - 2.1.2 EFFLUENT MONITORING SUMMARY MILFORD (DONEGAL) WWTP -
 - 2.1.3 Ambient Monitoring Summary for The Treatment Plant Discharge -
 - 2.1.4 OPERATIONAL REPORTS SUMMARY FOR MILFORD (DONEGAL) WWTP
 - 2.1.5 SLUDGE/OTHER INPUTS TO MILFORD (DONEGAL) WWTP

3 COMPLAINTS AND INCIDENTS

- 3.1 COMPLAINTS SUMMARY
- 3.2 REPORTED INCIDENTS SUMMARY
 - 3.2.1 SUMMARY OF INCIDENTS
 - 3.2.2 Summary of Overall Incidents

4 INFRASTRUCTURAL ASSESSMENT AND PROGRAMME OF IMPROVEMENTS

- 4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT
 - 4.1.1 SWO IDENTIFICATION AND INSPECTION SUMMARY REPORT
- 4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS
- 4.2.1 Specified Improvement Programme Summary
- 4.2.2 IMPROVEMENT PROGRAMME SUMMARY
- 4.2.3 SEWER INTEGRITY RISK ASSESSMENT

5 LICENCE SPECIFIC REPORTS

- 5.1 PRIORITY SUBSTANCES ASSESSMENT
- 5.2 SMALL STREAM RISK SCORE ASSESSMENT

6 CERTIFICATION AND SIGN OFF

6.1 Summary of AER Contents

7 APPENDIX

7.1 SMALL STREAM RISK SCORE ASSESSMENT

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2021 AER

This Annual Environmental Report has been prepared for D0342-01, Milford, in Donegal in accordance with the requirements of the wastewater discharge licence for the agglomeration. Specified reports where relevant are included as an appendix to the AER.

1.1 ANNUAL STATEMENT OF MEASURES

A summary of any improvements undertaken is provided where applicable.

Milford is on the Irish Water Capital Investment Programme.

1.2 TREATMENT SUMMARY

The agglomeration is served by a wastewater treatment plant(s)

• MILFORD (DONEGAL) WWTP with a Plant Capacity PE of 920, the treatment type is 2 - Secondary treatment

1.3 ELV OVERVIEW

The overall compliance of the final effluent with the Emission Limit Values (ELVs) is shown below. More detailed information on the below ELV's can be found in Section 2.

Discharge Point Reference	Treatment Plant	Discharge Type	Compliance Status	Parameters failing if relevant
TPEFF0600D0342SW001	MILFORD (DONEGAL) WWTP	Treated	Non-Compliant	Ammonia-Total (as N) mg/l BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l COD-Cr mg/l ortho-Phosphate (as P) - unspecified mg/l Suspended Solids mg/l

1.4 LICENCE SPECIFIC REPORTING

Assessment / Report

Small Stream Risk Score Assessment

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

2.1 MILFORD (DONEGAL) WWTP - TREATED DISCHARGE

2.1.1 INFLUENT MONITORING SUMMARY - MILFORD (DONEGAL) WWTP

A summary of influent monitoring for the treatment plant is presented below. This monitoring is primarily undertaken in order to determine the overall efficiency of the plant in removing pollutants from the raw wastewater.

Parameters	Number of Samples	Annual Max	Annual Mean
Total Phosphorus (as P) mg/l	12	7.00	2.68
Ammonia-Total (as N) mg/l	12	57	15
COD-Cr mg/l	12	360	134
ortho-Phosphate (as P) - unspecified mg/l	12	5.73	1.98
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	12	130	60
pH pH units	12	8.30	7.50
Total Nitrogen mg/l	12	68	25
Suspended Solids mg/l	12	196	76
Hydraulic Capacity	N/A	4706	1627

If other inputs in the form of sludge / leachate are added to the WWTP then these are included in Section 2.1.5 if applicable.

Significance of Results:

The annual mean hydraulic loading is greater than the peak Treatment Plant Capacity. The annual maximum hydraulic loading is greater than the peak Treatment Plant Capacity. Further details on the plant capacity and efficiency can be found under the sectional 'Operational Performance Summary'.

2.1.2 EFFLUENT MONITORING SUMMARY - TPEFF0600D0342SW001

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
COD-Cr mg/l	125	250	N/A	12	2	1	62	Fail
Suspended Solids mg/l	25	62	N/A	12	4	N/A	19	Fail
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	10	20	N/A	12	3	2	11	Fail
pH pH units	9.00	9.00	N/A	12	N/A	N/A	7.29	Pass
Ammonia-Total (as N) mg/l	0.650	1.30	N/A	12	12	11	13	Fail
ortho-Phosphate (as P) - unspecified mg/l	0.340	0.680	N/A	12	11	6	1.08	Fail
Total Nitrogen mg/l	N/A	N/A	N/A	12	N/A	N/A	17	

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
Conductivity @20°C µS/cm	N/A	N/A	N/A	12	N/A	N/A	439	
Total Phosphorus (as P) mg/l	N/A	N/A	N/A	12	N/A	N/A	1.42	

Notes:

- 1 This represents the Emission Limit Values after the Interpretation provided for under Condition 2 of the licence is applied
- 2 For pH the WWDA specifies a range of pH 6 9

Cause of Exceedance(s):

Plant is over loaded

Significance of Results:

The Parameters that exceeded are Ammonia, cBOD, COD, orthophosphate and suspended solids

2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE TPEFF0600D0342SW001

A summary of monitoring from ambient monitoring points associated with the wastewater discharge is provided in the sections below. For discharges to rivers upstream (U/S) and downstream (D/S) location data is provided. For other ambient points in lakes, coastal or transitional waters, monitoring data from the most appropriate monitoring station is selected.

The table below provides details of ambient monitoring locations and details of any designations as sensitive areas.

Ambient Monitoring Point from WWDL (or as agreed with EPA)	Irish Grid Reference	River Station Code	Bathing Water	Drinking Water	FWPM	Shellfish	WFD Ecological Status
Upstream	219277, 426509	RS39M010150	No	No	No	No	Poor
Downstream	218606, 424918	RS39M010300	No	No	No	No	Poor

The table below provides a summary of monitoring results for designated ambient monitoring points. The upstream and downstream annual mean values are shown (mg/l), and the difference between both monitoring stations is given as a percentage of the Environmental Quality Standard (EQS) where relevant.

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
BOD - 5 days (Total) mg/l	RS39M010150	1.64	RS39M010300	1.78	1.50	9.7
Ammonia-Total (as N) mg/l	RS39M010150	0.095	RS39M010300	0.783	0.065	1057.7
ortho-Phosphate (as P) - unspecified mg/l	RS39M010150	0.040	RS39M010300	0.114	0.035	209.2
pH pH units	RS39M010150	7.45	RS39M010300	7.09	N/A	
Temperature °C	RS39M010150	11	RS39M010300	11	N/A	
Conductivity @20°C µS/cm	RS39M010150	258	RS39M010300	248	N/A	
Dissolved Oxygen % Saturation	RS39M010150	88	RS39M010300	61	N/A	
Total Phosphorus (as P) mg/l	RS39M010150	0.052	RS39M010300	0.134	N/A	

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
Suspended Solids mg/l	RS39M010150	13	RS39M010300	9.68	N/A	
Total Nitrogen mg/l	RS39M010150	1.49	RS39M010300	2.26	N/A	

Significance of Results:

The WWTP discharge was not compliant with the ELV's set in the wastewater discharge licence.

The ambient monitoring results do not meet the required EQS at the upstream and the downstream monitoring locations. The EQS relates to the Oxygenation and Nutrient Conditions set out in the Surface Water Regulations 2009.

Based on ambient monitoring results a deterioration in Ammonia, BOD and Ortho-Phosphate, concentrations downstream of the effluent discharge is noted.

A deterioration in water quality has been identified, however it is not known if it or is not caused by the WWTP.

Other causes of deterioration in water quality in the area are: Unknown

The discharge from the wastewater treatment plant does not have an observable negative impact on the Water Framework Directive status.

2.1.4 OPERATIONAL PERFORMANCE SUMMARY - MILFORD (DONEGAL) WWTP

2.1.4.1 Treatment Efficiency Report - MILFORD (DONEGAL) WWTP

Treatment efficiency is based on the removal of key pollutants from the influent wastewater by the treatment plant. In essence the calculation is based on the balance of load coming into the plant versus the load leaving the plant. The efficiency is presented as a percentage removal rate.

A summary presentation of the efficiency of the treatment process including information for all the parameters specified in the licence is included below:

Parameter	Influent mass loading (kg/year)	Effluent mass emission (kg/year)	Efficiency (% reduction of influent load)	
COD	79541	36637	54	

Parameter	Influent mass loading (kg/year)	Effluent mass emission (kg/year)	Efficiency (% reduction of influent load)	
ТР	1595	846	47	
cBOD	35683	6368	82	
TN	14787	10372	30	
ss	44892	11268	75	

Note: The above data is based on sample results for the number of dates reported

2.1.4.2 Treatment Capacity Report Summary - MILFORD (DONEGAL) WWTP

Treatment capacity is an assessment of the hydraulic (flow) and organic (the amount of pollutants) load a treatment plant is designed to treat versus the current loading of that plant.

MILFORD (DONEGAL) WWTP					
Peak Hydraulic Capacity (m³/day) - As Constructed					
DWF to the Treatment Plant (m³/day) Current Hydraulic Loading - annual max (m³/day)					
					Average Hydraulic loading to the Treatment Plant (m³/day)
Organic Capacity (PE) - As Constructed	920				
Organic Capacity (PE) - Collected Load (peak week)Note1	1708				
Organic Capacity (PE) - Remaining					
Will the capacity be exceeded in the next three years? (Yes/No)	Yes				

Nominal design capacities can be based on conservative design principles. In some cases assessment of existing plants has shown organic capacities significantly higher than the nominal design capacity. Accordingly plants that appear to be overloaded when comparing a collected peak load with the nominal design capacity can be fully compliant due to the safety factors in the original design.

2.1.5 SLUDGE / OTHER INPUTS - MILFORD (DONEGAL) WWTP

'Other inputs' to the waste water treatment plant are summarised in table below

Input type	Quantity	Unit	P.E.	% of load to WWTP	Included in Influent Monitoring (Y/N)?	Is there a leachate/sludge acceptance procedure for the WWTP?	Is there a dedicated leachate/sludge acceptance facility for the WWTP? (Y/N)	
There is no Sludge and Other Input data for the Treatment Plant included in the AER.								

3 COMPLAINTS AND INCIDENTS

3.1 COMPLAINTS SUMMARY

A summary of complaints of an environmental nature related to the discharge(s) to water from the WWTP and network is included below.

Number of Complaints	Nature of Complaint	Number Open Complaints	Number Closed Complaints				
There were no relevant environmental complaints in 2021.							

3.2 REPORTED INCIDENTS SUMMARY

Environmental incidents that arise in an agglomeration are reported on an on-going basis in accordance with our waste water discharge licences. Where an incident occurs and it is reportable under the licence, it is reported to the Environmental Protection Agency through their Environmental Data Exchange Network, or in some instances by telephone. Some incidents which arise in the agglomeration are recorded by Irish Water but may not be reportable under our licence for example where the incident does not have an impact on environmental performance.

A summary of reported incidents is included below.

3.2.1 SUMMARY OF INCIDENTS

Incident Type	Cause	No. of incident occurrences	Recurring (Y/N)	Closed (Y/N)
Breach of ELV	WWTP operating above capacity	1	Yes	No

3.2.2 SUMMARY OF OVERALL INCIDENTS

Question	Answer
Number of Incidents in 2021	1
Number of Incidents reported to the EPA via EDEN in 2021	1
Explanation of any discrepancies between the two numbers above	N/A

4 INFRASTRUCTURAL ASSESSMENTS AND PROGRAMME OF IMPROVEMENTS

4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT

A summary of the operation of the storm water overflows and their significance where known is included below:

4.1.1 SWO IDENTIFICATION

WWDL Name / Code for Storm Water Overflow (chamber) where applicable	Irish Grid Ref. (outfall)	Included in Schedule of the WWDL	Significance of the overflow(High / Medium / Low)	Assessed against DoEHLG Criteria	No. of times activated in 2021 (No. of events)	Total volume discharged in 2021 (m3)	Monitoring Status
SW2	219193, 426466	Yes	Low	Meeting	Unknown	Unknown	Not Monitored
SW3	219289, 426522	Yes	Low	Meeting	Unknown	Unknown	Not Monitored

Any TBC SWO(s) were identified as part of the on-going National SWO programme and will be updated in subsequent AER(s) once the information is confirmed.

SWO Summary	
How much sewage was discharged via SWOs in the agglomeration in the year (m3)?	Unknown
Is each SWO identified as not meeting DoEHLG Guidance included in the Programme of Improvements?	N/A
The SWO Assessment included the requirements of relevant of WWDL schedules?	Yes
Have the EPA been advised of any additional SWOs / changes to Schedule C3 and A4 under Condition 1.7?	N/A

4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS.

4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0342-SIP:01	Infiltration programme - diversion of storm water from the sewer collection network	С	31/12/2012	Yes	Not Started		No works scoped. Proposed stormwater handling facilities at Milford will deal with incoming infiltration.
D0342-SIP:02	Installation of storm water storage tank	С	31/12/2017	Yes	At Planning Stage	2025	
D0342-SIP:03	Redesign WWTP inlet works for better flow control	С	31/12/2012	Yes	Works Completed		
D0342-SIP:04	Upgrading of Storm Water Overflows to comply with the criteria outlined in the DoECLG 'Procedures and Criteria in relation to Storm Water overflows, 1995'	С	31/12/2017	Yes	At Planning Stage		At tender stage 2024+

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0342-SIP:05	WWTP expansion and upgrade to provide tertiary treatment	С	31/12/2017	Yes	At Planning Stage	2025	

A summary of the status of any other improvements identified by under Condition 5 assessments- is included below.

4.2.2 IMPROVEMENT PROGRAMME SUMMARY

Improvement Identifier	nt Improvement Description / or any Operational Improvements		Expected Completion Date	Comments			
No additional improvements planned at this time.							

4.2.3 SEWER INTEGRITY RISK ASSESSMENT

The utilisation of multiple capital maintenance programmes and the outputs of the workshops with the Local Authority Operations Staff held under the programme can be used to satisfy the requirements of Condition 5 regarding network integrity. Improvement works identified by way of these programmes and workshops will be included in the Improvements Summary Tables 4.2.1 and 4.2.2.

5 LICENCE SPECIFIC REPORTS

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Licence Specific Report	Required by licence	Year included in AER	Included in this AER
Priority Substances Assessment	Yes	2015	No
Small Stream Risk Score Assessment	Yes	2016	Yes

6 CERTIFICATION AND SIGN OFF

6.1 SUMMARY OF AER CONTENTS

Parameter	Answer
Does the AER include an Executive Summary?	Yes
Does the AER include an assessment of the performance of the Waste Water Works (i.e. have the results of assessments been interpreted against WWDL requirements and or Environmental Quality Standards)?	Yes
Has a Technical amendment/licence review application been submitted to the Agency by IW?	No
List reason e.g. additional SWO identified	N/A
Is there a need to request/advise the EPA of any modification to the existing WWDL with respect to condition 4 changes to monitoring location, frequency etc	No
List reason e.g. changes to monitoring requirements	N/A
Have these processes commenced?	N/A
Are all outstanding reports and assessments from previous AERs included as an appendix to this AER	Yes

I certify that the information given in this Annual Environmental Report is truthful, accurate and complete:

Signed: Date: 07/06/2022

This AER has been produced by Irish Water's Environmental Information System (EIMS) and has been electronically signed off in that system for and on behalf of ,

Katherine Walshe

Acting Head of Environmental Regulation.

7 APPENDIX


Appendix

Appendix 7.1 - Small Stream Risk Score Assessment

River: Maga	gies Bun dis	Code:	Dat	e: 18/3	/2021	Time:	10	.00		
Station no.		Location:)austre			Grid (6 figure				
212500 74	+9	Stream Orde	r:			Stream flow:				
Field Cl	hemistry	Modifications: Y	/N Canalisad ii	delegant to the	1	Riffle				
DO%	80.1	arterial drainage		/luenea-bank er	rosion-	Riffle/Glide				
DO mg/I	0	Dominant Types				Slow flow				
Temp (°C)	161	- Bedrock								
Conductivity	252	Boulder (>128mm Cobble (32-128mn			-					
pH	7-2	Gravel (8-32mm)	1)		-					
Bank width (cm)		Fine Gravel (2-8mr	n)		_					
Wet width (cm)	100	Sand (0.25-2mm)	•							
Avg Depth (cm)	100	Silt (<0.25mm)			11(1)					
Staff gauge	60	Slope: Low Med	ium – High – V	'ery High				The Real Property and the		
Velocity	Colour	Geology: Calcared				Shading: High	lodera	ate - Low - N	one	
Torrential	None				1	~				
Fast	Slight	Substratum Cond Loose - Normal	intion: Calcare	:ous-Compacted	d- 1	Cattle access Y: u	pstrea	m – downstr	eam or N	
Moderate	Moderate	Substratum:								
Slow	High	Stoney bottom-Muc	idy bottom-Nu	d over stones		Photo: Y / N				
Very slow Clarity	Die	Degree of siltation			TAVE	PHOLO: Y / N				
Very clear	Discharge Flood	Depth of mud: No								
Clear	Normal				> 10cm					
	Norman	Litter: None Pres		e - Abundant	!					
Slightly turbid	Low	Filamentous Alga None - Present - M	e:	and a set	5	Sewage Eungus:				
Highly turbid	Very Low	Main land use u/s	s:	Sample		lone Present Mo	oderati	e - Abundant		
	Dry	Pasture	Urban	retained:		Cond net x	es: _	5		
	Recent Flood	Bog	Tillage	Y/N	1	_				
		Forestry	Other			tone wash x 3				
Group I = El	pnemeroptera (3-tai	Macroinvertebr the following 5 specif lls) – note that tails ma	ic groups:	d element	na			Relative Abunda		
Group 3 = Tr Group 4 = G Group 5 = 48	richoptera .OL.D (Gastropoda, . <i>sellus</i>	note that tails may be Oligochaeta and Dipte a and relative abunda	damaged durii era)	ng sampling		elow: (Abundance –	Ab)	1-5 6-20 21-50 5t-100 101+	t 2 3 4 5	
Ephemeroptera:		Ecdyonurus Ab	Plecop				,		1	
		Rhithrogena Ab						Leuctra Ab		
		Heptagenia Ab						<i>Isoperla</i> Ab		
		Ephemerella Ab						<i>nemura</i> Ab		
		Caenis Ab					Amphi	<i>inemura</i> Ab		
	Par	raleptophlebia Ab						<i>Perla</i> Ab		
		emera danica Ab					L	Dinocras Ab		
							Other	Plecop Ab		
Total no. of taxa		Other Ephem Ab		_			Other	Plecop Ab		
	1		7 Total n	o. of Taxa	0	Total Relat			0	
Trichoptera:	Hydropsychidae			Pa (G) Ab	Ch	ironomidae (D) Ab		Asellus:		
	Polycentropodidae		Potamopyrgu	<i>IS</i> (G) Ab		Chironomus (D) Ab	-	Abser	nt	
	Rhyacophila			s (G) Ab		Simuliidae (D) Ab	4	Few/Low		
	Philopotamidae			s (G) Ab		Dicranota (D) Ab		Common/		
	Limnephilidae			a (G) Ab		Tipulidae (D) Ab		Numerous		
	Sericostomatidae			5 (OI) Ab 5	Cerat	opogonidae (D) Ab				
-	Glossosomatidae		Eiseniella			Other GOLD Ab		NOTE: As	ellus	
	Lepidostomatidae Other Trichoptera		Tubificidae	(OI) Ab 4				must be		
Total no. of								recorded a absent if n		
Taxa	Total Rela Abunda	rive /	Total no. o	of Taxa 3	Total	Relative Abundance	13	are found	0.10	
NOTE Problem		1		1 -		Roundance	, –			

NOTE *Baetis* is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that *Baetis* is not counted in SSRS. See Appendix B for more details on how to identify *Baetis*.

Step 1. Calculate the Index Score by circling the appropriate box representing the total number of taxa and the total abundance calculated from *each macroinvertebrate group* calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

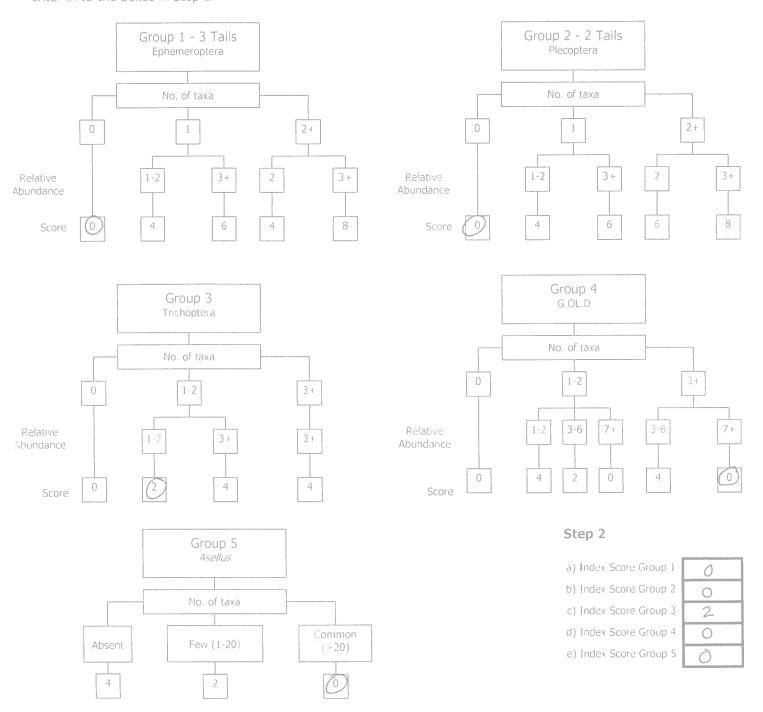

Step 3. Calculate the Total Index Score, the Average Index Score and the SSR Score using the boxes below


rotal Index Score (115 sum (a+b+c+d+e	e) 2 Averag	S/5 (5 for 5 groups)	0.4	(AIS x 2)	0,8
Step 4. Assess the stream b	by comparing the final S	SR score with the	categories below an	d tick the appropri	ate box
> 7.25 Probably not at risk	> 6.5 - 7.25 Indeterminate Stream may be at risk	< 6. Stream at ris	5 5 6		

Surveyor (signed): Dan Smith Name (print): Dan Smith Date: 8 / 3 2021

River: P	lagger from US	Code:	Date	a: 18/	3/2021	Time:		0.2.	
Station no.		Location:	upstrea				-1:	9:30	
212500	748	Stream Order				Grid (6 figur	e):		
Field	Chemistry					Stream flow: Riffle			
D0%	91.2	Modifications: Y/ arterial drainage	N Canalised-wi	dened-bank	erosion-	Riffle/Glide>			
DO mg/l		Dominant Types:				Slow flow			
Temp (°C)	10.4	Boulder (>128mm)	_			-			
Conductivity	248	Cobble (32-128mm)	>						
рH	7.3	Gravel (8-32mm)	•						
Bank width (cm)	200	Fine Gravel (2-8mm	1)						
Wet width (cm)	200	Sand (0.25-2mm) Silt (<0.25mm)							
Avg Depth (cm)	30	Slope: Low Media	List V						
Staff gauge				_		Shadings High	N4 I		
Velocity Torrential	Colour None	Geology: Calcareou				Shading: High	Modera	ate Low (N	one
Fast	Slight	Substratum Cond Loose - Normal	ition: Calcared	ous-Compacte	ed-	Cattle access Y: (pstrea	am downstra	eam of N
Moderate	Moderate	Substratum:							3411
Slow	High	Stoney bottom-Mude	dy bottom-Muc	over stones	\supset	Dhata, V (V)			
Very slow Clarity	Discharge	Degree of siltation				Photo: Y N			
Very clear	Flood	Depth of mud: Nor							
Clear	Normal	Litter: None - Prese	ont - Modorato	AL. J-10CIII.	>10CM				
Clichtly to the				- Abundant					
Slightly turbid	Low	Filamentous Algae None – Present – Mo	:: Iderate - Abun	dant		Sewage Fungus:			
Highly turbid	Very Low	Main land use u/s:	COLUMN ADUIT	Sample		None - Present - M	oderat	e - Abundant	
	Dry Recent Flood	Pasture	Urban	retained	ı:	Sampled in Minut Pond net x	es: _	>	
	Recent Flood	Bog Forestry	Tillage Other	Y / N		Stone wash x 3			
General Comme			Other			Weed sweep x	•		
Group I -	Ephemerontera (3-tails) - note that tails	groups:		l:			Relative Abundar	
Group 3 = Group 4 = Group 5 =	Trichoptera G.OL.D (Gastropoda O	igochaeta and Diptera	amaged during	g sampling		below: (Ahundanco	۸۵۱	1-5 6-20 21-50 51-100 101+	1 2 3 4 5
Ephemeroptera:		Ecdyonurus Ab	Plecopt			, ibandance	1		
		Rhithrogena Ab	- Песорі	.c.a.				<i>Leuctra</i> Ab	
		Heptagenia Ab						<i>Isoperla</i> Ab	
	E	phemerella Ab						<i>nemura</i> Ab	
		Caenis Ab					Amphi	<i>nemura</i> Ab	
	Parale	eptophlebia Ab						Perla Ab	
	Ephen	nera danica Ab						<i>Dinocras</i> Ab	
	Ot	her Ephem Ab	_					Plecop Ab	
Total no. of tax		e Abundance O	Total no.	of Taxa				Plecop Ab	
Trichoptera:	Hydropsychidae A		Lymnaea		0	Total Relat	ive At		0
	Polycentropodidae A		Potamopyrgus		J	hironomidae (D) Ab		Asellus:	
	Rhyacophila A	b	Planorbis			Chironomus (D) Ab		Absen	
	Philopotamidae A	The state of the s	Ancylus			Simuliidae (D) Ab Dicranota (D) Ab	2_	Few/Low	
	Limnephilidae A		Physa			Tipulidae (D) Ab	1	Common/ Numerous	
	Sericostomatidae A		Lumbriculus (Cera	atopogonidae D Ab	<u> </u>	11011101005	
34	Glossosomatidae A		Eiseniella (Ol) Ab		Other GOLD Ab	1	NOTE: Ase	llus
	Lepidostomatidae A Other Trichoptera Ab		Tubificidae (Ol) Ab		70		must be	
Total no. of								recorded as absent if no	
Taxa	2 Total Relative		Total no. of	Taxa 7	Total	Relative Abundance	Ø	are found	HE
NOTE Parti				- 1 '	1		0		

NOTE Baetis is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that Baetis is not counted in SSRS. See Appendix B for more details on how to identify Baetis.

Step 1. Calculate the Index Score by circling the appropriate box representing the total number of taxa and the total abundance calculated from *each macroinvertebrate group* calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

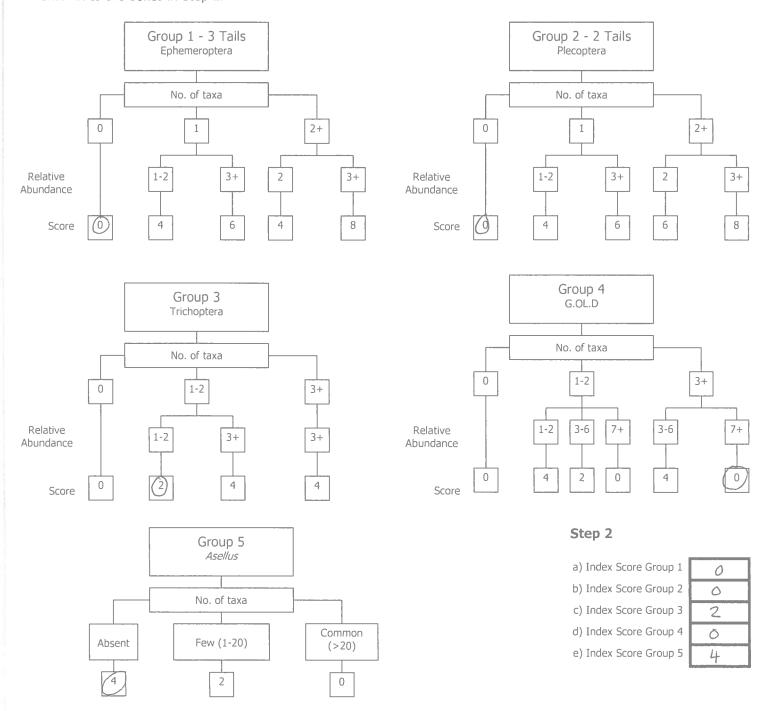

Step 3. Calculate the Total Index Score, the Average Index Score and the SSR Score using the boxes below

> 6.5 - 7.25

> 7.25

Total Index Score (TIS) 6 Average Index Score (AIS) 1.2 SSR Score (AIS × 2)

< 6.5

Step 4. Assess the stream by comparing the final SSR score with the categories below and tick the appropriate box

