

Annual Environmental Report

2023



Edgeworthstown

D0098-01

CONTENTS

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2023 AER

- 1.1 ANNUAL STATEMENT OF MEASURES
- 1.2 TREATMENT SUMMARY
- 1.3 ELV OVERVIEW
- 1.4 LICENSE SPECIFIC REPORT INCLUDED IN AER

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

- 2.1 EDGEWORTHSTOWN WWTP - TREATED DISCHARGE
 - 2.1.1 INFLUENT SUMMARY - EDGEWORTHSTOWN WWTP
 - 2.1.2 EFFLUENT MONITORING SUMMARY - EDGEWORTHSTOWN WWTP
 - 2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE
 - 2.1.4 OPERATIONAL REPORTS SUMMARY FOR EDGEWORTHSTOWN WWTP
 - 2.1.5 SLUDGE/OTHER INPUTS TO EDGEWORTHSTOWN WWTP

3 COMPLAINTS AND INCIDENTS

- 3.1 COMPLAINTS SUMMARY
- 3.2 REPORTED INCIDENTS SUMMARY
 - 3.2.1 SUMMARY OF INCIDENTS
 - 3.2.2 SUMMARY OF OVERALL INCIDENTS

4 INFRASTRUCTURAL ASSESSMENT AND PROGRAMME OF IMPROVEMENTS

- 4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT
 - 4.1.1 SWO IDENTIFICATION AND INSPECTION SUMMARY REPORT
- 4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS
 - 4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY
 - 4.2.2 IMPROVEMENT PROGRAMME SUMMARY
 - 4.2.3 SEWER INTEGRITY RISK ASSESSMENT

5 LICENCE SPECIFIC REPORTS

- 5.1 SMALL STREAM RISK SCORE ASSESSMENT

6 CERTIFICATION AND SIGN OFF

- 6.1 SUMMARY OF AER CONTENTS

7 APPENDIX

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2023 AER

This Annual Environmental Report has been prepared for D0098-01, Edgeworthstown, in Longford in accordance with the requirements of the wastewater discharge licence for the agglomeration. Specified reports where relevant are included as an appendix to the AER.

1.1 ANNUAL STATEMENT OF MEASURES

A summary of any improvements undertaken is provided where applicable.

There were no capital works, significant changes or operational changes undertaken in 2023.

1.2 TREATMENT SUMMARY

The agglomeration is served by a wastewater treatment plant(s)

- Edgeworthstown WWTP with a Plant Capacity PE of 2700, the treatment type is 3P - Tertiary P removal.

1.3 ELV OVERVIEW

The overall compliance of the final effluent with the Emission Limit Values (ELVs) is shown below. More detailed information on the below ELV's can be found in Section 2.

Discharge Point Reference	Treatment Plant	Discharge Type	Compliance Status	Parameters failing if relevant
TPEFF2000D0098SW001	Edgeworthstown WWTP	Treated	Non-Compliant	Ammonia-Total (as N) mg/l

1.4 LICENCE SPECIFIC REPORTING

Assessment / Report

Small Stream Risk Score Assessment

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

2.1 EDGEWORTHSTOWN WWTP - TREATED DISCHARGE

2.1.1 INFLUENT MONITORING SUMMARY - EDGEWORTHSTOWN WWTP

A summary of influent monitoring for the treatment plant is presented below. This monitoring is primarily undertaken in order to determine the overall efficiency of the plant in removing pollutants from the raw wastewater.

Parameters	Number of Samples	Annual Max	Annual Mean
Suspended Solids mg/l	12	4524	559
Total Nitrogen mg/l	12	117	43
Ammonia-Total (as N) mg/l	12	36	21
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	12	930	213
ortho-Phosphate (as P) - unspecified mg/l	12	7.34	3.60
Total Phosphorus (as P) mg/l	12	15	5.65
COD-Cr mg/l	12	1970	457
pH pH units	12	8.23	7.49
Hydraulic Capacity	N/A	2871	1336

If other inputs in the form of sludge / leachate are added to the WWTP then these are included in Section 2.1.5 if applicable.

Significance of Results:

The annual mean hydraulic loading is less than the peak Treatment Plant Capacity. The annual maximum hydraulic loading is greater than the peak Treatment Plant Capacity. Further details on the plant capacity and efficiency can be found under the sectional 'Operational Performance Summary'.

2.1.2 EFFLUENT MONITORING SUMMARY - TPEFF2000D0098SW001

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
COD-Cr mg/l	125	250	N/A	12	N/A	N/A	21	Pass
Suspended Solids mg/l	35	87.5	N/A	12	N/A	N/A	9.72	Pass
Temperature °C	25	25	N/A	12	N/A	N/A	10.50	Pass
pH pH units	6	9	N/A	12	N/A	N/A	7.33	Pass
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	6	12	N/A	12	1	N/A	2.56	Pass
Total Phosphorus (as P) mg/l	2	2.4	N/A	12	N/A	N/A	0.262	Pass
Ammonia-Total (as N) mg/l	0.3	0.6	N/A	12	3	2	0.222	Fail

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
ortho-Phosphate (as P) - unspecified mg/l	0.15	0.3	N/A	12	N/A	N/A	0.082	Pass
Total Nitrogen mg/l	N/A	N/A	N/A	12	N/A	N/A	19	
Conductivity @20°C µS/cm	N/A	N/A	N/A	12	N/A	N/A	980	
Alkalinity-total (as CaCO₃) mg/l	N/A	N/A	N/A	7	N/A	N/A	131	
Visual Inspection Descriptive	N/A	N/A	N/A	12	N/A	N/A	N/A	

Notes:

1 – This represents the Emission Limit Values after the Interpretation provided for under Condition 2 of the licence is applied

2 – For pH the WWDA specifies a range of pH 6 - 9

Cause of Exceedance(s):

WWTP upgrade required to meet ELV.

Significance of Results:

The WWTP is non compliant with the ELV's set in the Wastewater Discharge Licence. The impact on receiving waters is assessed further in Section 2

2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE TPEFF2000D0098SW001

A summary of monitoring from ambient monitoring points associated with the wastewater discharge is provided in the sections below. For discharges to rivers upstream (U/S) and downstream (D/S) location data is provided. For other ambient points in lakes, coastal or transitional waters, monitoring data from the most appropriate monitoring station is selected.

The table below provides details of ambient monitoring locations and details of any designations as sensitive areas.

Ambient Monitoring Point from WWDL (or as agreed with EPA)	Irish Grid Reference	River Station Code	Bathing Water	Drinking Water	FWPM	Shellfish	WFD Ecological Status
Upstream	226006, 271139	RS26B050050	No	No	No	No	Poor
Downstream	226103, 270544	RS26B050080	No	No	No	No	Poor

The results for ambient results and / or additional monitoring data sets are included in the **Appendix 7.1 - Ambient Monitoring Summary**.

Significance of Results:

The WWTP discharge was not compliant with the ELV's set in the wastewater discharge licence for the following: Ammonia-Total (as N) mg/l.

The ambient monitoring results do not meet the required EQS at the upstream and the downstream monitoring locations. The EQS relates to the Oxygenation and Nutrient Conditions set out in the Surface Water Regulations 2009.

Based on ambient monitoring results a deterioration in BOD and Ammonia concentrations downstream of the effluent discharge is noted.

A deterioration in water quality has been identified, however it is not known if it or is not caused by the WWTP.

Other causes of deterioration in water quality in the area are unknown.

The discharge from the wastewater treatment plant does have an observable negative impact on the Water Framework Directive status.

2.1.4 OPERATIONAL PERFORMANCE SUMMARY - EDGEWORTHSTOWN WWTP

2.1.4.1 Treatment Efficiency Report - Edgeworthstown WWTP

Treatment efficiency is based on the removal of key pollutants from the influent wastewater by the treatment plant. In essence the calculation is based on the balance of load coming into the plant versus the load leaving the plant. The efficiency is presented as a percentage removal rate.

A summary presentation of the efficiency of the treatment process including information for all the parameters specified in the licence is included below:

Parameter	Influent mass loading (kg/year)	Effluent mass emission (kg/year)	Efficiency (% reduction of influent load)
COD	227386	6680	97
TN	21323	6011	72
cBOD	106118	822	99
SS	277944	3117	99
TP	2808	84	97

Note: The above data is based on sample results for the number of dates reported.

2.1.4.2 Treatment Capacity Report Summary - Edgeworthstown WWTP

Treatment capacity is an assessment of the hydraulic (flow) and organic (the amount of pollutants) load a treatment plant is designed to treat versus the current loading of that plant.

Edgeworthstown WWTP	
Peak Hydraulic Capacity (m³/day) - As Constructed	1824
DWF to the Treatment Plant (m³/day)	608
Current Hydraulic Loading - annual max (m³/day)	2871
Average Hydraulic loading to the Treatment Plant (m³/day)	1336
Organic Capacity (PE) - As Constructed	2700
Organic Capacity (PE) - Collected Load (peak week)^{Note1}	2582
Organic Capacity (PE) - Remaining	118
Will the capacity be exceeded in the next three years? (Yes/No)	No

Nominal design capacities can be based on conservative design principles. In some cases assessment of existing plants has shown organic capacities significantly higher than the nominal design capacity. Accordingly plants that appear to be overloaded when comparing a collected peak load with the nominal design capacity can be fully compliant due to the safety factors in the original design.

2.1.5 SLUDGE / OTHER INPUTS - EDGEWORTHSTOWN WWTP

'Other inputs' to the waste water treatment plant are summarised in the table below.

Input type	Quantity	Unit	P.E.	% of load to WWTP	Included in Influent Monitoring (Y/N)?	Is there a leachate/sludge acceptance procedure for the WWTP?	Is there a dedicated leachate/sludge acceptance facility for the WWTP? (Y/N)
There is no Sludge and Other Input data for the Treatment Plant included in the AER.							

3 COMPLAINTS AND INCIDENTS

3.1 COMPLAINTS SUMMARY

A summary of complaints of an environmental nature related to the discharge(s) to water from the WWTP and network is included below.

Number of Complaints	Nature of Complaint	Number Open Complaints	Number Closed Complaints
There were no relevant environmental complaints in 2023.			

3.2 REPORTED INCIDENTS SUMMARY

Environmental incidents that arise in an agglomeration are reported on an on-going basis in accordance with our waste water discharge licences. Where an incident occurs and it is reportable under the licence, it is reported to the Environmental Protection Agency through their Environmental Data Exchange Network, or in some instances by telephone. Some incidents which arise in the agglomeration are recorded by Uisce Éireann but may not be reportable under our licence for example where the incident does not have an impact on environmental performance.

A summary of reported incidents is included below.

3.2.1 SUMMARY OF INCIDENTS

Incident Type	Cause	Recurring (Y/N)	Closed (Y/N)
Breach of ELV	WWTP upgrade required to meet ELV	Yes	No
Uncontrolled release	Inadequate Infrastructure	No	No

3.2.2 SUMMARY OF OVERALL INCIDENTS

Question	Answer
Number of Incidents in 2023	2
Number of Incidents reported to the EPA via EDEN in 2023	2
Explanation of any discrepancies between the two numbers above	N/A

4 INFRASTRUCTURAL ASSESSMENTS AND PROGRAMME OF IMPROVEMENTS

4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT

A summary of the operation of the storm water overflows and their significance where known is included below:

4.1.1 SWO IDENTIFICATION

WWDL Name / Code for Storm Water Overflow (chamber) where applicable	Irish Grid Ref. (outfall)	Included in Schedule of the WWDL	Significance of the overflow(High / Medium / Low)	Assessed against DoEHLG Criteria	No. of times activated in 2023 (No. of events)	Total volume discharged in 2023 (m ³)	Monitoring Status
SW3	226085 270587	Yes	Low Significance	Not Meeting Criteria	225	88492	Monitored
SW4	225650 271860	Yes	Low Significance	Meeting Criteria	Unknown	Unknown	Not Monitored
SW2	225746 271464	Yes	Low Significance	Meeting Criteria	Unknown	Unknown	Not Monitored

Any TBC SWO(s) were identified as part of the on-going National SWO programme and will be updated in subsequent AER(s) once the information is confirmed.

SWO Summary	
How much wastewater discharge by metered SWOs during the year (m ³)?	88492
Is each SWO identified as not meeting DoEHLG Guidance included in the Programme of Improvements?	No

SWO Summary	
The SWO Assessment included the requirements of relevant of WWDL schedules?	Yes
Have the EPA been advised of any additional SWOs / changes to Schedule C3 and A4 under Condition 1.7?	N/A

4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS

4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0098-SIP:01	SW2 Upgrading of Storm Water Overflows to comply with the criteria outlined in the DoEHLG "Procedures and Criteria in relation to Storm Water Overflows, 1995"	C	31/12/2016	Yes	Works Completed		
D0098-SIP:02	SW3 Upgrading of Storm Water Overflows to comply with the criteria outlined in the DoEHLG	C	31/12/2016	Yes	Works Completed		

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
	"Procedures and Criteria in relation to Storm Water Overflows, 1995"						
D0098-SIP:03	Waste water treatment plant and ancillary works	C	31/12/2014	Yes	Works Completed		

A summary of the status of any other improvements identified by under Condition 5 assessments- is included below.

4.2.2 IMPROVEMENT PROGRAMME SUMMARY

Improvement Identifier	Improvement Description / or any Operational Improvements	Improvement Source	Expected Completion Date	Comments
No additional improvements planned at this time.				

4.2.3 SEWER INTEGRITY RISK ASSESSMENT

N/A

5 LICENCE SPECIFIC REPORTS

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Licence Specific Report	Required by licence	Included in this AER
Small Stream Risk Score Assessment	Yes	Yes

6 CERTIFICATION AND SIGN OFF

6.1 SUMMARY OF AER CONTENTS

Parameter	Answer
Does the AER include an Executive Summary?	Yes
Does the AER include an assessment of the performance of the Waste Water Works (i.e. have the results of assessments been interpreted against WWDL requirements and or Environmental Quality Standards)?	Yes
Is there a need to advise the EPA for Consideration of a Technical Amendment/Review of the Licence?	Yes
List reason e.g. additional SWO identified	Capital upgrade
Is there a need to request/advise the EPA of any modification to the existing WWDL with respect to condition 4 changes to monitoring location, frequency etc	Yes
List reason e.g. changes to monitoring requirements	Ambient Monitoring Location Changes
Have these processes commenced?	No
Are all outstanding reports and assessments from previous AERs included as an appendix to this AER	Yes

I certify that the information given in this Annual Environmental Report is truthful, accurate and complete:

Date: 27/02/2024

This AER has been produced by Uisce Éireann's Environmental Information System (EIMS) and has been electronically signed off in that system for and on behalf of,

Eleanor Roche

Head of Environmental Regulation.

7 APPENDIX

Appendix
Appendix 7.1 - Ambient Monitoring Summary
Appendix 7.2 – Small Stream Risk Score Assessment

Edgeworthstown 2023 Ambient Monitoring Summary


Ambient Monitoring Point from WWDL (or as agreed with EPA)	Irish National Grid Reference (Easting, Northing)	EPA Feature Coding Tool code	Receiving Waters Designation (Yes/No)			
			Bathing Water	Drinking Water	FWPM	Shellfish
Upstream Monitoring Point	226006, 271139	RS26B050050	No	No	No	No
Downstream Monitoring Point	226103, 270544	RS26B050080	No	No	No	No

Ambient Monitoring Point from WWDL (or as agreed with EPA)	Current WFD Status	Mean (mg/l)		
		cBOD	o-Phosphate (as P)	Ammonia (as N)
Upstream Monitoring Point	Poor	1.10	0.047	0.063
Downstream Monitoring Point	Poor	1.70	0.043	0.155
<i>Difference</i>		<i>0.599</i>	<i>-0.004</i>	<i>0.091</i>
EQS		1.500	0.035	0.065
% of EQS		39.931%	-12.607%	140.590%

Edgeworthstown 2023 Ambient Monitoring Data

Station Name	Sample Date	BOD	Total N	Ortho P	Ammonia	pH	DO %	DO
		mg/l	mg/l	mg/l	mg/l	pH Units	&Sat	mg/l
Upstream	11/01/2023	1.90	1.400	0.078	0.067	7.46	8.46	77
Upstream	08/02/2023	<1	1.400	0.047	0.102	8.31	100.5	11.68
Upstream	08/03/2023	<1	1.400	0.041	0.036	8.38	106.2	11.6
Upstream	12/04/2023	1.30	1.400	0.037	0.080	7.99	11.42	104
Upstream	10/05/2023	1.3	0.9	0.052	0.056	8.1	96.8	9.99
Upstream	21/06/2023	1.80	1.1	0.046	0.182	7.61	75.3	7.62
Upstream	13/07/2023	<1	0.110	<0.006	0.082	8.41	111.9	11.48
Upstream	10/08/2023	<1	0.600	0.041	0.023	7.96	94.7	10.09
Upstream	13/09/2023	<1	0.9	0.081	0.046	8.19	128.7	12.03
Upstream	11/10/2023	1.60	<0.5	0.039	0.020	8.11	96.6	10.47
Upstream	08/11/2023	<1	1.3	0.070	0.022	7.97	101.1	10.65
Upstream	06/12/2023	<1	1.2	0.027	0.045	8.32	116.9	12.63
	Mean	1.10	1.01	0.047	0.063	8.07	87.38	24.10
	95%ile	1.85	1.40	0.079	0.138	8.39	122.21	89.15
Downstream	11/01/2023	1.90	1.400	0.078	0.061	7.43	97.9	10.74
Downstream	08/02/2023	<1	1.400	0.048	0.053	8.35	101.6	11.79
Downstream	08/03/2023	7.10	14.100	0.041	0.842	7.78	91.8	10.13
Downstream	12/04/2023	1.10	1.300	0.036	0.083	7.98	11.48	104
Downstream	10/05/2023	1.1	0.9	0.052	0.061	8.09	98	10.06
Downstream	21/06/2023	1.70	1.000	0.049	0.191	7.48	73.5	7.43
Downstream	13/07/2023	<1	<0.5	<0.006	0.026	8.39	109.2	11.42
Downstream	10/08/2023	1.30	1.300	0.080	0.162	8.15	91.5	9.69
Downstream	08/11/2023	0.71	1.400	0.013	0.020	7.92	104.1	10.81
Downstream	06/12/2023	<1	0.8	0.024	0.049	8.32	117	12.66
	Mean	1.70	2.40	0.043	0.155	7.99	89.61	19.87
	95%ile	4.76	8.38	0.079	0.549	8.37	113.49	62.90

Note: Where the concentration in the result is less than the limit of detection (LOD), a value of $LOD/\sqrt{2}$ was used in calculating the mean and 95%ile concentrations.



Noreen McLoughlin, MSc

Environmental Consultant

Whitehill
Edgeworthstown
Co. Longford
☎ (087) 4127248 / (043) 6672775
✉ noreen.mcloughlin@gmail.com

BIOLOGICAL WATER QUALITY ASSESSMENT OF THE RIVER BLACK, EDGEWORTHSTOWN, CO. LONGFORD (2023)



River Black at Tinnynarr

*Water Services Department
Longford County Council
December 2023*

TABLE OF CONTENTS

1	INTRODUCTION	3
2	METHODOLOGY	5
3	RECEIVING ENVIRONMENT	8
4	RESULTS OF THIS ASSESSMENT	11
5	DISCUSSION AND CONCLUSIONS	13
6	APPENDIX I- RESULTS OF RIVER BLACK MONITORING	14

1 INTRODUCTION

1.1 BACKGROUND

In February 2011, the Environmental Protection Agency issued a Waste Water Discharge License in respect of the waste water treatment plant at Edgeworthstown, Co. Longford (License No. D0098-0). This treatment plant discharges into the River Black at Tinnynarr, Edgeworthstown, Co. Longford. As part of the requirements for this license, it is necessary to monitor the biological quality of the River Black, both upstream and downstream of the waste water treatment plant discharge on an annual basis.

Since 2011, Whitehill Environmental has been commissioned by Longford County Council to undertake the annual investigation of the biological water quality of the River Black close to the discharge point of the treatment plant. This report presents the results of the 2023 monitoring programme.

Q VALUE ASSESSMENT

Along with other parameters (fish, morphology, chemistry), the Q value is used to determine the ecological status of the waterbody, which is an action required under the obligations set out in the EU Water Framework Directive. Under this Directive, all water bodies are required to meet good status within a certain time period. Ireland is now in the second cycle of the Water Framework Directive and therefore good status should be achieved in all water bodies by the end of this current cycle, i.e., 2027. If a waterbody is unlikely to achieve this status, then it is deemed to be *At Risk*. Table 1 summaries the Q values in relation to Water Framework Directive status.

Q Value	WFD Status	Pollution Status	Condition
Q5, Q4-5	High	Unpolluted	Satisfactory
Q4	Good	Unpolluted	Satisfactory
Q3-4	Moderate	Slightly polluted	Unsatisfactory
Q3, Q2-3	Poor	Moderately polluted	Unsatisfactory
Q2, Q1-2, Q1	Bad	Seriously polluted	Unsatisfactory

Table 1 – Q Rating in Relation to WFD Status

SMALL STREAM RISK SCORE (SSRS)

The Small Stream Risk Score (SSRS) is a biological risk assessment system for detecting potential sources of pollution in streams. The main aim of the SSRS is to support the programme of measures for the Water Framework Directive. The main objective of this directive is to ensure the achievement of good ecological status in all water bodies in the EU within a specified time period.

SSRS surveys are designed to assist in the identification of diffuse sources of pollution and they are valuable in pinpointing the likely geographical location of the sources that are causing the main channel rivers in their failure to achieve good status. The SSRS will identify whether the water body in question is At Risk of not achieving good ecological status as required under the Water Framework Directive.

2 METHODOLOGY

2.1 PERSONNEL

This ecological assessment was carried out by Noreen McLoughlin, BA, MSc, MCIEEM, of Whitehill Environmental. Noreen has an honours degree in Zoology and an MSc in Freshwater Ecology from Trinity College, Dublin and she has been a full member of the Chartered Institute of Ecology and Environmental Managements for 18 years. Noreen has over 20 years' experience as a professional ecologist in Ireland.

2.2 BIOLOGICAL ASSESSMENT

Biological water quality assessment was carried out at two separate locations on the River Black, both upstream and downstream of the effluent discharge point. These locations are summarised in Table 1 and illustrated in Figure 1.

Station No.	Location	NGR Location
1	~ 35m u/s of discharge	N 260517 70648
2	~35m d/s of discharge	N 26046 70574
	Discharge Point	N 26009 70652

Table 1 – Stations Sampled as Part of this Assessment

Fieldwork was carried out on 4th December 2023.

At each station, the surrounding habitats were noted along with other parameters such as water flow, stream depth and the predominance of vegetation. All samples were taken with a Freshwater Biological Association approved hand held sweep net with a mesh diameter of 500µm. At both stations, a two minute kick and stone wash sample was taken at a suitable riffle site, if there was one present. The samples were retained in plastic containers at the sampling site and removed to the laboratory for further analysis. In the lab, any fine mud and debris were removed from each sample by sieving under running water through a 500 µm sieve. The samples were then sorted live in a white tray under a bench lamp. All macro-invertebrates were preserved in 70% methanol, before being counted and identified to the appropriate taxonomic level. This was generally to family level but where necessary to species level.

Based on the relative abundance of indicator species, a biotic index (Q rating) was determined for the sites in accordance with the biological assessment procedure used by the

Environmental Protection Agency. In addition, the Small Stream Risk Score (SSRS) was also calculated for the upstream and downstream stations. This assessment gives a quick overview of the risk status of the water body in question.

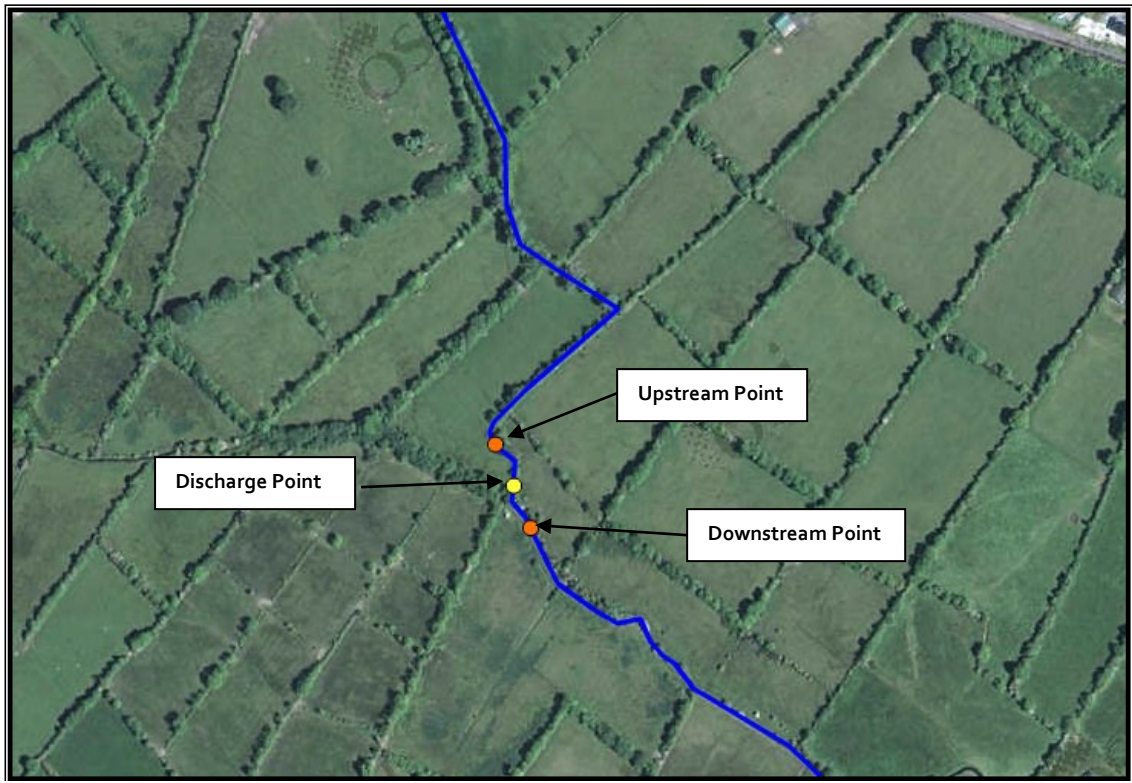


Figure 1 – Location of Sampling Points on the River Black

Q VALUE

Based on the relative abundance of indicator species, the Q value was determined for the sites in accordance with the biological assessment procedure used by the Environmental Protection Agency (Toner *et al.* 2005). The method categorises invertebrates into one of five different groups based on their sensitivity or tolerance to pollution. Group A are the most sensitive forms, Group B are less sensitive, Group C are tolerant, Group D are very tolerant and Group E are the most tolerant. Overall, the higher the biological diversity and the greater the abundance of invertebrate species that are sensitive to organic pollution, then the higher the water quality is assumed to be and the higher the Q value assigned to that sampling station.

The relative abundance of each group of invertebrates in the samples was assigned as follows:

- Present (1/2 individuals)
- Scarce/Few (<1%)
- Small Numbers (<5%)

- Fair Numbers (5-10%)
- Common (10-20%)
- Numerous (25-50%)
- Dominant (50-75%)
- Excessive (>75%)

SSRS

The SSRS methodology only uses certain biological indicators to calculate the risk. The taxa used have been placed into 5 groups:

Group 1 – Ephemeroptera (Mayflies)

Group 2 – Plecoptera (Stoneflies)

Group 3 – Trichoptera (Caddisflies)

Group 4 – G.O.I.D (Gastropods, Oligochaetes and Dipterns)

Group 5 – Asellus (Waterlouse)

The groupings are based on their sensitivity to organic pollution, e.g., mayflies and stoneflies are sensitive to pollution and are given a high score, whilst taxa within Group 4 are less sensitive and are given a lower score. The overall score for each river sample is based on the number of taxon present in each sample along with the relative abundance of each taxon. These scores are added together and divided by five to give an average index score (AIS). The final SSRS is achieved by multiplying the AIS by 2. Table 3 outlines the risk categories.

SSRS	Risk Category
<6.5	At Risk
6.5-7.25	Probably at Risk
>7.25	Not at Risk

Table 3 – SSRS Risk Categories

3 RECEIVING ENVIRONMENT

The Edgeworthstown waste water treatment plant is located in the townland of Tinnynarr, approximately 0.5km south of the town and just off the N4 Dublin – Sligo Road. It is surrounded mostly by agricultural / grazing land. The discharge from the treatment plant enters the River Black at a point approximately half a kilometre south of the treatment plant. A map showing the location of the treatment plant is shown in Figure 1.

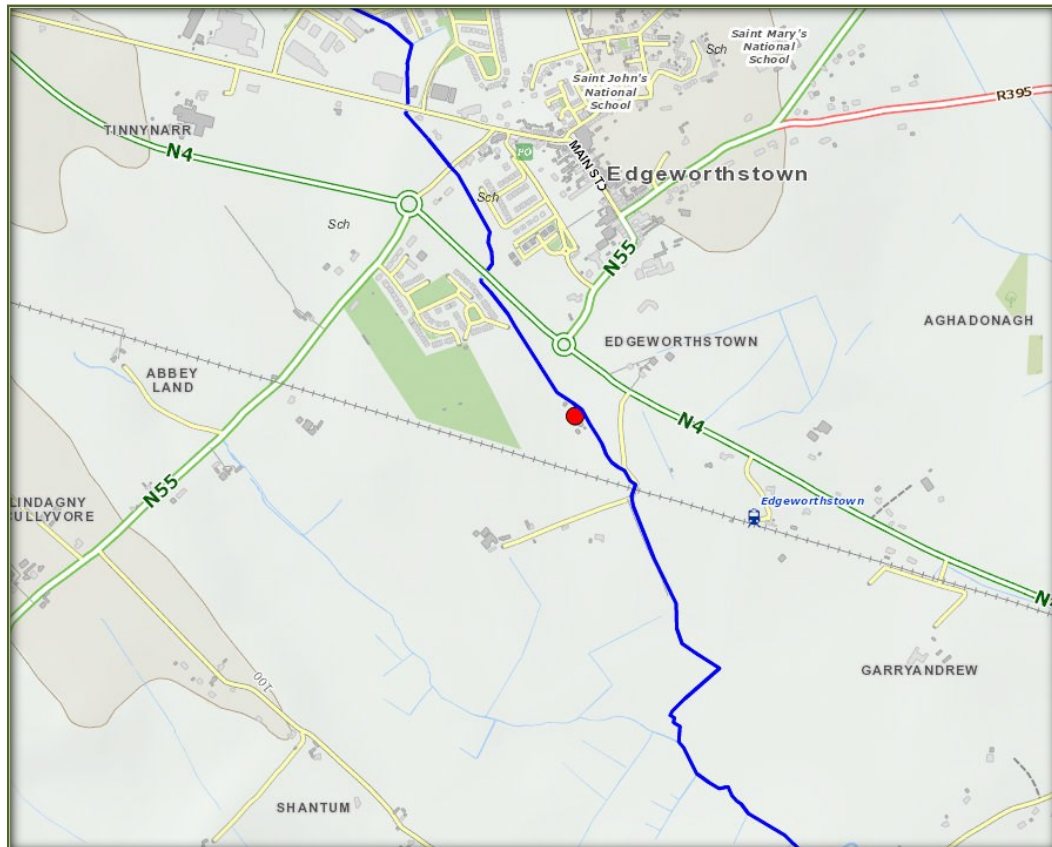


Figure 1 – Site Location Map. The Course of the River Black is Highlighted in Blue. The Location of the Treatment Plant is Shown with a Red Dot.

3.1 THE RIVER BLACK

The River Black rises in the townland of Lisnanagh, approximately 3km north-west of Edgeworthstown. It then flows through low lying agricultural land where it is joined by a network of drainage ditches. On the western outskirts of the town it flows behind a pet food factory and through a housing estate. On the east side of the town it flows through agricultural land again and towards the Longford – Westmeath county boundary where it flows through an area of raised and cutover bog and a conifer plantation. Historically (old version OSI maps) the River Black flowed into and out of Glen Lough (prior to the drainage scheme that drained this lake) before it flowed north-east and then south-east towards the River Inny, where it joined it in the townland of Boltomy just downstream of Lough Iron.

However, since the lake was drained the flow of the river has been altered and it is now connected to the marsh area of Glen Lough by a drainage channel.

3.2 RECEIVING WATER QUALITY

EPA'S BIOLOGICAL WATER QUALITY MONITORING

Since the commencement of the EPA's Water Quality Monitoring Programme, the River Black has consistently failed to reach good ecological status, i.e., it has always been of poor – moderate water quality. The earliest information from the EPA comes from 1987, when a Q value of 1-2 (i.e., bad status / severe pollution) was assigned to the river at the sampling station at the Ballymahon Bridge in Edgeworthstown (upstream of the waste water treatment plant).

In 2020, the River Black at the Ballymahon Road Bridge received a Q₃ (Poor Ecological Status). This is a slight improvement since 2017 when a Q₂₋₃ was obtained. However, it is a deterioration since 2011, when a Q₃₋₄ (moderate status) was obtained. Other points sampled by the EPA include the bridge at Ballinlaghta and the bridge at Lissanure. The latest EPA ratings (2017 and 2020) from the Ballinlaghta station is a Q₃, i.e., moderate status. This is a deterioration from 2014, when a Q₃₋₄ was obtained.

PREVIOUS MONITORING RESULTS

Tables 2 and 3 summarise the previous results obtained by Whitehill Environmental during the biological water quality monitoring studies on the River Black. The 2010 results were obtained as part of the Appropriate Assessment Screening for the original license application. Subsequent results were obtained upon condition of the granting of the license. The SSRS for the River Black only commenced in 2016.

Year	Q Value & Status Upstream	Q Value & Status Downstream
2010	Q3: Poor Status	Q3: Poor Status
2011	Q3: Poor Status	Q3: Poor Status
2012 (2013)	Q3: Poor Status	Q3-4: Moderate Status
2013	Q3: Poor Status	Q3: Poor Status
2015	Q3: Poor Status	Q3: Poor Status
2016	Q3: Poor Status	Q3: Poor Status
2017	Q3: Poor Status	Q3: Poor Status
2018	Q3: Poor Status	Q2-3: Poor Status
2019	Q3: Poor Status	Q2-3: Poor Status
2020	Q3: Poor Status	Q3: Poor Status
2021	Q3: Poor Status	Q2-3: Poor Status
2022	Q3: Poor Status	Q2-3: Poor Status

Table 2 – Summary of Findings of the Previous Biological Water Quality Assessment.

Year	SSRS & Risk Status Upstream	SSRS & Risk Status Downstream
2016	1.6	3.2
2017	1.6	4
2018	2.4	1.6
2019	1.6	1.6
2020	0.8	1.6
2021	2.4	1.6
2022	4	0.8

Table 3 – Summary of Findings of the Previous SSRS for the River Black

4 RESULTS OF THIS ASSESSMENT

Results from the current biological water quality monitoring are summarised in Table 3.

Station	Location	Q Value & Status	SSRS
1	~ 35m u/s of discharge	Q ₃ - <i>Poor Status</i>	4
2	~ 35m d/s of	Q ₃ - <i>Poor Status</i>	1.6

Table 3 – Summary of Findings of the 2022 Biological Water Quality Assessment

STATION ONE

The River Black at Station 1 (upstream) was taken from a location where the depth of the water was approximately 20-30cm. The stream width is less than 2m here and the substrate consists of cobbles and small boulders which are compacted with calcium deposits in some locations. The level of silt in the stream was moderately low and confined to the stream bed underneath the stones and cobbles. The flow on the day was moderately fast. The water was clear with a low level of silt, there was no turbidity or evidence of excessive algal growth. The sample was taken from suitable riffle and glide type habitats.

The sample from station 1 (upstream of discharge) was dominated by Group C taxa, which comprised 90.3% of the total faunal assemblage. Group C macro-invertebrates are tolerant of moderate levels of organic pollution. The most abundant taxon in the sample was the freshwater shrimp *Gammarus duebeni*, which comprised 56% of the fauna and overall, this taxon dominated the sample. The mayfly *Baetis rhodani* was numerous in the sample at almost 25%. Other Group C taxa present included dipteran larvae from the Chironomidae family and this occurred in small numbers. Caseless caddis were also present and represented by the Hydropsychidae and Polycentropodidae families. Group A taxa (most sensitive to organic pollution) were absent, and Group B (less sensitive) was represented in small numbers by cased caddis from the Limnephilidae family. Group D taxa were present in the sample in fair numbers (6.4%) and they were represented by the water louse *Asellus aquaticus* and leeches. Group D taxa are tolerant of organic pollution. Based on the relative abundance of these indicator groups with the excessiveness of Group C taxa and the presence of Group D taxa in fair numbers, this station was assigned a Q₃, i.e., poor status. Under the requirements of the EU Water Framework Directive, this is unsatisfactory.

The SSRS obtained at Station 1 was also low (4), putting it within the At Risk category.

STATION TWO

The River Black at Station 2 (downstream) was taken from a location where the depth of the water was approximately 30-40cm. The sample was taken downstream of the confluence of the River Black with another stream that joins it from the west. The stream width is less than 2m here and the substrate consists of pebbles and cobbles. There was an abundance of sewage fungus present in the sample.

Station 2 (downstream of the discharge) was also dominated by Group C taxa. They were excessive in the sample and they comprised over 95% of the total faunal assemblage. The dominant taxon in the sample were diptern larvae from the Simuliidae family (57%). Diptern larvae from the Chironomid family were also numerous. The mayfly *Baetis rhodani* was present in small numbers only. The most sensitive Group A and B taxa were absent from this sample. Group D taxa were present in small numbers in the sample and were represented by the water louse *Asellus aquaticus* and leeches from the Glossiphoniidae and Erpobdellidae families. Group E taxa, which are extremely tolerant of pollution were absent.

Overall, based on the relative abundance of these indicator groups and the overall proportions of Groups C and D, this station was assigned a Q₃, i.e., poor status.

The SSRS obtained at this station was 1.6, which puts this station in the At Risk category.

5 DISCUSSION AND CONCLUSIONS

There has been no significant change in the ecological status of the River Black upstream of the discharge. It has maintained its Q₃, which is the value it has received since the start of this monitoring programme. The SSRS score of 4 was maintained the same as 2022, which remains the highest SSRS score to date. However, the river at this point remains within the *At Risk* category. Morphologically the stream at this point looks satisfactory as it has a good riffle / glide system, with a low level of silt and relatively clear water.

The downstream station remains at poor status, although some improvement in this station was noted since 2022 as the Q value has increased from a Q₂₋₃ to a Q₃. This was due to a lowering of the overall proportions of Group D taxa compared to 2022. The level of silt and filamentous algae in the sample was high, which also points to poor ecological status. The SSRS score here remains low (1.6) but there was a slight increase from that observed in 2022 (0.8).

Overall, it can be concluded that there is a deterioration in the ecological status of the River Black from upstream of the discharge point to downstream of the discharge point.

6 APPENDIX I- RESULTS OF RIVER BLACK MONITORING

Station One (Upstream) – Q Value

Indicator Group	Taxon	Number	Abundance
Group A	Absent	0	0
(Very sensitive)			
Group B		10	2.9
(Moderately sensitive)	Caseless Trichoptera		
	Limnephilidae	10	2.9
Group C		308	90.3
(Moderately tolerant)	Ephemeroptera		
	<i>Baetis rhodani</i>	85	24.9
	<i>Ephemerella ignita</i>	1	0.3
	Amphipoda		
	<i>Gammarus duebeni</i>	191	56
	Diptera		
	Chironomidae	17	4.9
	Simuliidae	1	0.3
	Caseless Trichoptera		
	Hydropsychidae	5	1.46
	Polycentropodidae	6	1.75
	Gastropoda		
	Lymnaeidae	2	0.6
Group D		22	6.45
(Very tolerant)	Isopoda		
	<i>Asellus aquaticus</i>	19	5.6
	Hirudinea		
	Glossiphoniidae	2	0.6
	Sphaeriidae		
	Pisidium	1	0.3
Group E	Absent	0	0
(Most tolerant)			
Not Assigned		1	0.3
	Oligochaeta		
	Lumbriculidae	1	0.3
Total Abundance		341	
Q Value	Q3 – Poor Status		

Results from the Biological Water Quality Monitoring of Station One (Upstream of Discharge)

Station Two (Downstream) – Q Value

Indicator Group	Taxon	Number	Abundance
Group A	Absent	0	0
(Very sensitive)			
Group B	Absent	0	0
(Moderately sensitive)			
Group C		502	95.4
(Moderately tolerant)	Ephemeroptera		
	<i>Baetis rhodani</i>	48	9
	Diptera		
	Chironomidae	148	28
	Simuliidae	300	57
	Dicranota	4	0.76
	Caseless Trichoptera		
	Polycentropodidae	2	0.38
Group D		8	1.52
(Very tolerant)	Isopoda		
	<i>Asellus aquaticus</i>	4	0.76
	Hirudinea		
	Erpobdellidae	2	0.38
	<i>Glossiphoniidae</i>	2	0.38
Group E	Absent	0	0
(Most tolerant)			
Not Assigned		16	3
	Oligochaeta		
	Lumbriculidae	16	3
Total Abundance		526	
Q Value	Q3 Poor Status		

Results from the Biological Water Quality Monitoring of Station Two (Downstream of Discharge)

Indicator Group	Taxon	No of Taxa	Total Relative Abundance ^{*2}	Score
Group 1	Ephemeroptera	1	1	4
Group 2	Plecoptera	0	0	0
Group 3	Trichoptera	3	5	4
Group 4	G O I D	4	5	0
Group 5	<i>Asellus aquaticus</i>		Few	2
Total Index Score (TIS)				10
Average Index Score (AIS = TIS/5)				2
SSR Score (AIS x 2)				4
SSRS Category				At Risk

SSRS (Upstream)

Indicator Group	Taxon	No of Taxa	Total Relative Abundance ^{*2}	Score
Group 1	Ephemeroptera	0	0	0
Group 2	Plecoptera	0	0	0
Group 3	Trichoptera	1	1	2
Group 4	G O I D	4	12	0
Group 5	<i>Asellus aquaticus</i>		Common	2
Total Index Score (TIS)				4
Average Index Score (AIS = TIS/5)				0.8
SSR Score (AIS x 2)				1.6
SSRS Category				At Risk

SSRS (Downstream)